

SUBJECT: University Building and Fire Code Compliance	Effective Date: 5/30/12	Policy Number: FSP 2012 EHS0001
	Supersedes:	Page Of 1 7
	Responsible Authority: Director of Environmental Health and Safety	

APPLICABILITY/ACCOUNTABILITY:

This procedure applies to all departments, supporting personnel, and functional units within Facilities and Safety.

POLICY STATEMENT:

All renovations, remodels, additions, alterations, or new construction on any UCF campus, whether done by internal or external entities, must be approved by the Environmental Health and Safety Building Code Administrator to ensure compliance with building and fire codes. The Environmental Health and Safety Building Code Administrator is the university authority for all building code issues at the university. The Environmental Health and Safety Fire Safety Coordinator is the UCF liaison with the State Fire Marshal, who is the legal authority for all fire code issues.

DEFINITIONS:

Plans Review. A formal review of construction documents or design drawings for compliance with building and/or fire codes.

Building Permit. A legal document issued by the appropriate authorities authorizing new construction or major alterations to existing structures. This document, in accordance with Florida law, must be posted and displayed on the construction site.

PROCEDURES:

1. Five identical sets of drawings or documents for the proposed work are submitted to Environmental Health and Safety for plans review. See the Building Code website for plans review fees and a document review form.

2. The Building Code Administrator submits drawings to the State Fire Marshal for fire code plans review, when required, while simultaneously reviewing the rest of the drawings for building code compliance.
3. Once both fire and building code plans reviews are satisfactorily completed, the contractor will apply for a building permit. See the Building Code Website for permit fees and application forms.
4. Once the permit fees are paid, a building permit is issued and must be posted at the job site for the duration of the work.
5. The work is inspected during and after construction as spelled out in the Florida Building Code section 110 inspections (Appendix A). After both fire code and building code final inspections are satisfactorily completed, the Building Code Administrator will issue a certificate of occupancy or a certificate of completion.
6. New or significantly renovated facilities may not be occupied prior to the issuance of a certificate of occupancy.

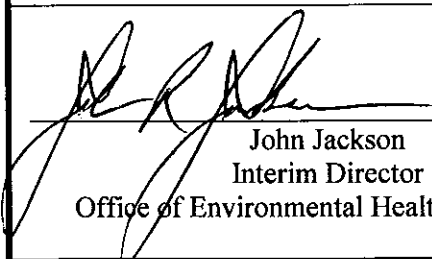
FORMS AND RELATED INFORMATION:

<http://www.ehs.ucf.edu/buildingfire/buildingcode.html>

CONTACTS:

Environmental Health and Safety Building and Fire Code Office
 Facilities and Safety Building 16
 P.O. Box 163500
 Orlando, FL 32816-3500
 (407) 823-5323

INITIATING AUTHORITY: Vice President for Administration and Finance

Approved By:	Date Approved:
 <hr/> John Jackson Interim Director Office of Environmental Health and Safety	<hr/> 5/30/12

Appendix (A)

2010 Florida Building Code

- 1.1. In flood hazard areas, upon placement of the lowest floor, including basement, and prior to further vertical construction, the elevation certification shall be submitted to the authority having jurisdiction.
2. Framing inspection. To be made after the roof, all framing, fireblocking and bracing is in place, all concealing wiring, all pipes, chimneys, ducts and vents are complete and shall at a minimum include the following building components:
 - Window/door framing
 - Vertical cells/columns
 - Lintel/tie beams
 - Framing/trusses/bracing/connectors
 - Draft stopping/fire blocking
 - Curtain wall framing
 - Energy insulation
 - Accessibility.
 - Verify rough opening dimensions are within tolerances.
3. Sheathing inspection. To be made either as part of a dry-in inspection or done separately at the request of the contractor after all roof and wall sheathing and fasteners are complete and shall at a minimum include the following building components:
 - Roof sheathing
 - Wall sheathing
 - Sheathing fasteners
 - Roof/wall dry-in.
4. Roofing inspection. Shall at a minimum include the following building components:
 - Dry-in
 - Insulation
 - Roof coverings
 - Flashing
5. Final inspection. To be made after the building is completed and ready for occupancy.
 - 5.1. In flood hazard areas, as part of the final inspection, a final certification of the lowest floor elevation shall be submitted to the authority having jurisdiction.
6. Swimming pool inspection. First inspection to be made after excavation and installation of reinforcing steel, bonding and main drain, and prior to placing of concrete.

Final inspection to be made when the swimming pool is complete and all required enclosure requirements are in place.

In order to pass final inspection and receive a certificate of completion, a residential swimming pool must meet the requirements relating to pool safety features as described in Section 424.2.17.
7. Demolition inspections. First inspection to be made after all utility connections have been disconnected and secured in such manner that no unsafe or unsanitary conditions shall exist during or after demolition operations.

Final inspection to be made after all demolition work is completed.

8. Manufactured building inspections. The building department shall inspect construction of foundations; connecting buildings to foundations; installation of parts identified on plans as site installed items, joining the modules, including utility crossovers; utility connections from the building to utility lines on site; and any other work done on site which requires compliance with the *Florida Building Code*. Additional inspections may be required for public educational facilities (see Section 423.27.20).
9. Where impact resistant coverings or impact resistant systems are installed, the building official shall schedule adequate inspections of impact resistant coverings or impact resistant systems to determine the following:

The system indicated on the plans was installed.

The system is installed in accordance with the manufacturer's installation instructions and the product approval.

Electrical

1. Underground inspection. To be made after trenches or ditches are excavated, conduit or cable installed, and before any backfill is put in place.
2. Rough-in inspection. To be made after the roof, framing, fireblocking and bracing is in place and prior to the installation of wall or ceiling membranes.
3. Final inspection. To be made after the building is complete, all required electrical fixtures are in place and properly connected or protected, and the structure is ready for occupancy.

Plumbing

1. Underground inspection. To be made after trenches or ditches are excavated, piping installed, and before any backfill is put in place.
2. Rough-in inspection. To be made after the roof, framing, fireblocking and bracing is in place and all soil, waste and vent piping is complete, and prior to this installation of wall or ceiling membranes.
3. Final inspection. To be made after the building is complete, all plumbing fixtures are in place and properly connected, and the structure is ready for occupancy.

Note: See Section P312 of the *Florida Building Code, Plumbing* for required tests.

Mechanical

1. Underground inspection. To be made after trenches or ditches are excavated, underground duct and fuel piping installed, and before any backfill is put in place.
2. Rough-in inspection. To be made after the roof, framing, fire blocking and bracing are in place and all ducting, and other concealed components are complete, and prior to the installation of wall or ceiling membranes.

3. Final inspection. To be made after the building is complete, the mechanical system is in place and properly connected, and the structure is ready for occupancy.

Gas

1. Rough piping inspection. To be made after all new piping authorized by the permit has been installed, and before any such piping has been covered or concealed or any fixtures or gas appliances have been connected.
2. Final piping inspection. To be made after all piping authorized by the permit has been installed and after all portions which are to be concealed by plastering or otherwise have been so concealed, and before any fixtures or gas appliances have been connected. This inspection shall include a pressure test.
3. Final inspection. To be made on all new gas work authorized by the permit and such portions of existing systems as may be affected by new work or any changes, to ensure compliance with all the requirements of this code and to assure that the installation and construction of the gas system is in accordance with reviewed plans.

110.3.1 Footing and foundation inspection. Reserved.

110.3.2 Concrete slab and under-floor inspection. Reserved.

110.3.3 Reinforcing steel and structural frames. Reinforcing steel or structural framework of any part of any building or structure shall not be covered or concealed without first obtaining a release from the building official.

110.3.4 Termites. Building components and building surroundings required to be protected from termite damage in accordance with Section 1503.7, Section 2304.13 or Section 2304.11.6, specifically required to be inspected for termites in accordance with Section 2114, or required to have chemical soil treatment in accordance with Section 1816 shall not be covered or concealed until the release from the building official has been received.

110.3.5 Shoring. For threshold buildings, shoring and associated formwork or falsework shall be designed and inspected by a Florida licensed professional engineer, employed by the permit holder or subcontractor, prior to any required mandatory inspections by the threshold building inspector.

110.3.6 Fire- and smoke-resistant penetrations. Protection of joints and penetrations in fire-resistance-rated assemblies, *smoke barriers* and smoke partitions shall not be concealed from view until inspected and *approved*.

110.3.7 Threshold building.

110.3.7.1 The enforcing agency shall require a special inspector to perform structural inspections on a threshold building pursuant to a structural inspection plan prepared by the engineer or architect of record. The structural inspection plan must be submitted to the enforcing agency prior to the issuance of a building permit for the construction of a threshold building. The purpose of the structural inspection plan is to provide specific inspection procedures and schedules so that the

building can be adequately inspected for compliance with the permitted documents. The special inspector may not serve as a surrogate in carrying out the responsibilities of the building official, the architect, or the engineer of record. The contractor's contractual or statutory obligations are not relieved by any action of the special inspector.

110.3.7.2 The special inspector shall determine that a professional engineer who specializes in shoring design has inspected the shoring and reshoring for conformance with the shoring and reshoring plans submitted to the enforcing agency. A fee simple title owner of a building, which does not meet the minimum size, height, occupancy, occupancy classification, or number-of-stories criteria which would result in classification as a threshold building under Section 553.71(7), may designate such building as a threshold building, subject to more than the minimum number of inspections required by the *Florida Building Code*.

110.3.7.3 The fee owner of a threshold building shall select and pay all costs of employing a special inspector, but the special inspector shall be responsible to the enforcement agency. The inspector shall be a person certified, licensed or registered under Chapter 471, *Florida Statutes*, as an engineer, or under Chapter 481, *Florida Statutes*, as an architect.

110.3.7.4 Each enforcement agency shall require that, on every threshold building:

110.3.7.4.1 The special inspector, upon completion of the building and prior to the issuance of a certificate of occupancy, file a signed and sealed statement with the enforcement agency in substantially the following form: "To the best of my knowledge and belief, the above described construction of all structural load-bearing components complies with the permitted documents, and the shoring and reshoring conforms to the shoring and reshoring plans submitted to the enforcement agency."

110.3.7.4.2 Any proposal to install an alternate structural product or system to which building codes apply be submitted to the enforcement agency for review for compliance with the codes and made part of the enforcement agency's recorded set of permit documents.

110.3.7.4.3 All shoring and reshoring procedures, plans and details be submitted to the enforcement agency for recordkeeping. Each shoring and reshoring installation shall be supervised, inspected and certified to be in compliance with the shoring documents by the contractor.

110.3.7.4.4 All plans for the building which are required to be signed and sealed by the architect or engineer of record contain a statement that, to the best of the architect's or engineer's knowledge, the plans and specifications comply with the applicable minimum building codes and the applicable fire-safety standards as determined by the local authority in

accordance with this section and Chapter 633, *Florida Statutes*.

110.3.7.5 No enforcing agency may issue a building permit for construction of any threshold building except to a licensed general contractor, as defined in Section 489.105(3)(a), *Florida Statutes*, or to a licensed building contractor, as defined in Section 489.105(3)(b), *Florida Statutes*, within the scope of her or his license. The named contractor to whom the building permit is issued shall have the responsibility for supervision, direction, management and control of the construction activities on the project for which the building permit was issued.

110.3.7.6 The building department may allow a special inspector to conduct the minimum structural inspection of threshold buildings required by this code, Section 553.73, *Florida Statutes*, without duplicative inspection by the building department. The building official is responsible for ensuring that any person conducting inspections is qualified as a building inspector under Part XII of Chapter 468, *Florida Statutes*, or certified as a special inspector under Chapter 471 or 481, *Florida Statutes*. Inspections of threshold buildings required by Section 553.79(5), *Florida Statutes*, are in addition to the minimum inspections required by this code.

110.3.8 Other inspections. Reserved.

110.3.9 Special inspections. Reserved.

110.3.10 Final inspections. Reserved.

110.4 Inspection agencies. Reserved.

110.5 Inspection requests. It shall be the duty of the holder of the building permit or their duly authorized agent to notify the building official when work is ready for inspection. It shall be the duty of the permit holder to provide access to and means for inspections of such work that are required by this code.

110.6 Approval required. Work shall not be done beyond the point indicated in each successive inspection without first obtaining the approval of the building official. The building official, upon notification, shall make the requested inspections and shall either indicate the portion of the construction that is satisfactory as completed, or notify the permit holder or his or her agent wherein the same fails to comply with this code. Any portions that do not comply shall be corrected and such portion shall not be covered or concealed until authorized by the building official.

SECTION 111 CERTIFICATE OF OCCUPANCY

111.1 Use and occupancy. No building or structure shall be used or occupied, and no change in the existing occupancy classification of a building or structure or portion thereof shall be made, until the building official has issued a certificate of occupancy therefor as provided herein. Issuance of a certificate of occupancy shall not be construed as an approval of a violation of the provisions of this code or of other ordinances of the jurisdiction.

Exception: Certificates of occupancy are not required for work exempt from permits under Section 105.2.

111.2 Certificate issued. After the building official inspects the building or structure and finds no violations of the provisions of this code or other laws that are enforced by the department of building safety, the building official shall issue a certificate of occupancy that contains the following:

1. The building permit number.
2. The address of the structure.
3. The name and address of the owner.
4. A description of that portion of the structure for which the certificate is issued.
5. A statement that the described portion of the structure has been inspected for compliance with the requirements of this code for the occupancy and division of occupancy and the use for which the proposed occupancy is classified.
6. For buildings and structures in flood hazard areas, a statement that documentation of the as-built lowest floor elevation has been provided and is retained in the records of the department of building safety.
7. The name of the building official.
8. The edition of the code under which the permit was issued.
9. The use and occupancy, in accordance with the provisions of Chapter 3.
10. The type of construction as defined in Chapter 6.
11. The design occupant load.
12. If an automatic sprinkler system is provided, whether the sprinkler system is required.
13. Any special stipulations and conditions of the building permit.

111.3 Temporary occupancy. The building official is authorized to issue a temporary certificate of occupancy before the completion of the entire work covered by the permit, provided that such portion or portions shall be occupied safely. The building official shall set a time period during which the temporary certificate of occupancy is valid.

111.4 Certificate of Completion. A Certificate of Completion is proof that a structure or system is complete and for certain types of permits is released for use and may be connected to a utility system. This certificate does not grant authority to occupy a building, such as shell building, prior to the issuance of a Certificate of Occupancy.

111.5 Revocation. The building official is authorized to, in writing, suspend or revoke a certificate of occupancy or completion issued under the provisions of this code wherever the certificate is issued in error, or on the basis of incorrect information supplied, or where it is determined that the building or structure or portion thereof is in violation of any ordinance or regulation or any of the provisions of this code.